


1 BUILDING TYPE "A" FIRST FLOOR PLAN
 H102 SCALE 1/4" = 1'-0"

- GENERAL NOTES:
1. BALANCE SYSTEM TO AIR QUANTITIES SHOWN.
 2. PROVIDE ALL NECESSARY DAMPERS TO BALANCE SYSTEM DO NOT USE DAMPERS ON REGISTERS TO BALANCE SYSTEMS.
 3. DASHED DUCTWORK IS LOCATED IN THE CRAWL SPACE AND SERVES THE FIRST FLOOR AREAS. SOLID DUCTWORK IS LOCATED ABOVE THE FIRST FLOOR CEILING AND SERVES THE SECOND FLOOR SPACES.
 4. CLEAN ALL FURNACES AND DUCT PER SPECIFICATIONS.
 5. ATTACH AND SECURE ALL EXHAUST DUCTS IN FURNACE ROOMS.

DRAWING NOTES:
 ① PROVIDE NEW DAMPER W/ QUADRANT LOCKING HANDLE.

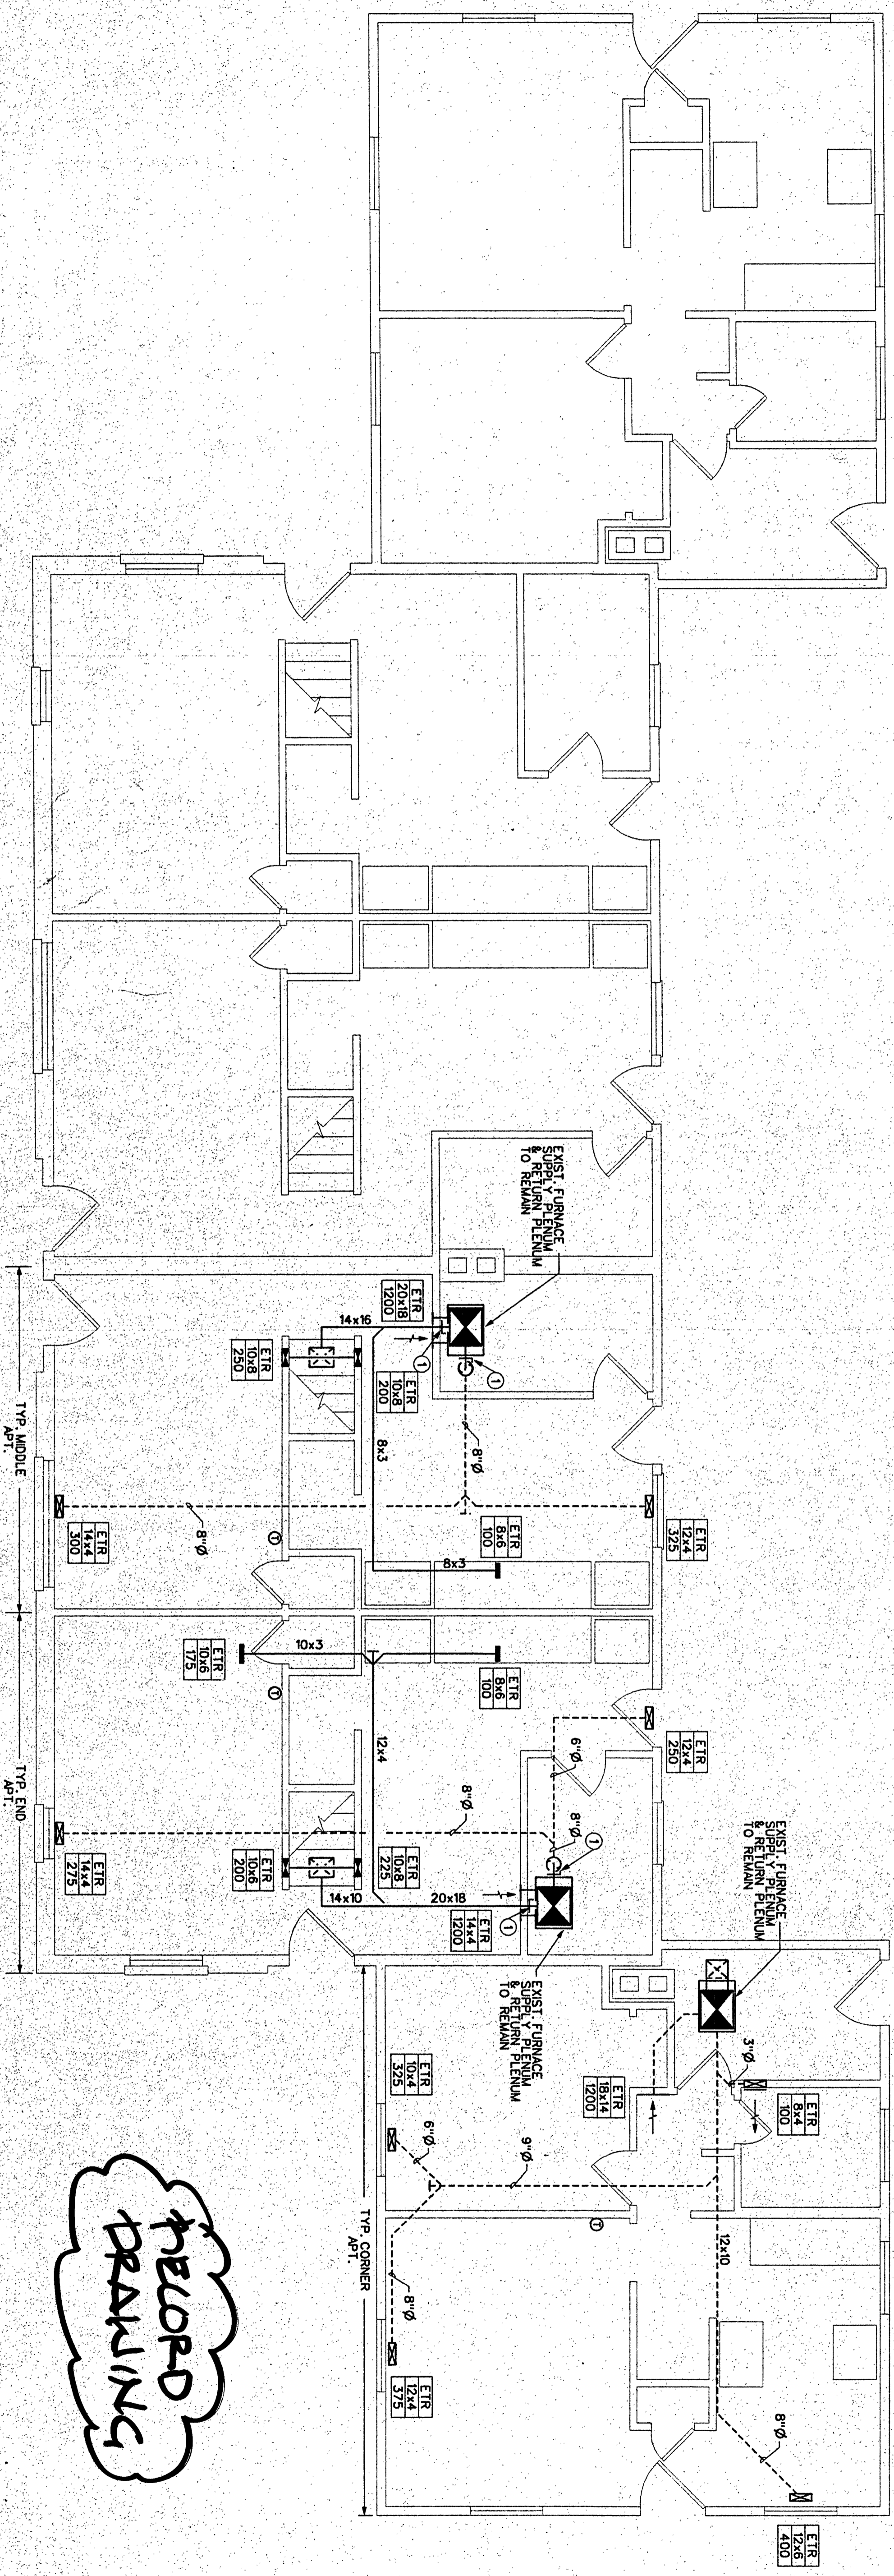

2 BUILDING TYPE "B" FIRST FLOOR PLAN
 H102 SCALE 1/4" = 1'-0"

Drawing alterations to this drawing is an exception from the New York State Education Law Article 145 section 2287 and applies to this drawing. It is a violation of this law for any person, unless acting under the direction of a licensed professional engineer, architect or engineer, shall affix his seal and the motion, altered by, followed by his signature and date, which shall be a false statement.

PROJECT 2 - IMPROVEMENTS TO VARIOUS LOW RISE DEVELOPMENTS
 TYPICAL TYPE "A" AND TYPE "B" UNITS - HVAC
**ARCHITECTURAL REPAIRS AND IMPROVEMENTS
 PROGRAM YEARS 2001-2002 CAPITAL FUND**
 NIAGARA FALLS HOUSING AUTHORITY
 744 TENTH STREET NIAGARA FALLS, NEW YORK 14301

Architect: **Architecture Unlimited**
 Phone: 716-692-1944
 15 Webster Street
 North Tonawanda, New York 14120

Consultants: **ME ENGINEERING P.C.**
 MECHANICAL/ELECTRICAL
 ENGINEERING CONSULTANTS
 WATERFRONT VILLAGE CENTER
 SUITE 200 62 LAURELTON BOULEVARD
 BUFFALO, NY 14202
 (716) 692-1100 FAX (716) 692-9167
 ME JOB #02250

Revision Number:
 Revision Date:
 Scale: **AS NOTED**
 Date: 02/01/02
 Drawn By:
 Checked By:
 Project: **02-20-CAP**
H102